

Example: Subject to change

Apparatus must not have more than 1/2 tank of fuel


### New England Fire/Rescue/EMS Expo

October 16-18, 2024  
Mohegan Sun Casino Resort  
Uncasville, Connecticut


### EARTH EXPO & CONVENTION CENTER

Booth...Count

- 
- 10x50.....2
- 10x40.....21
- 10x30.....23
- 10x10.....116

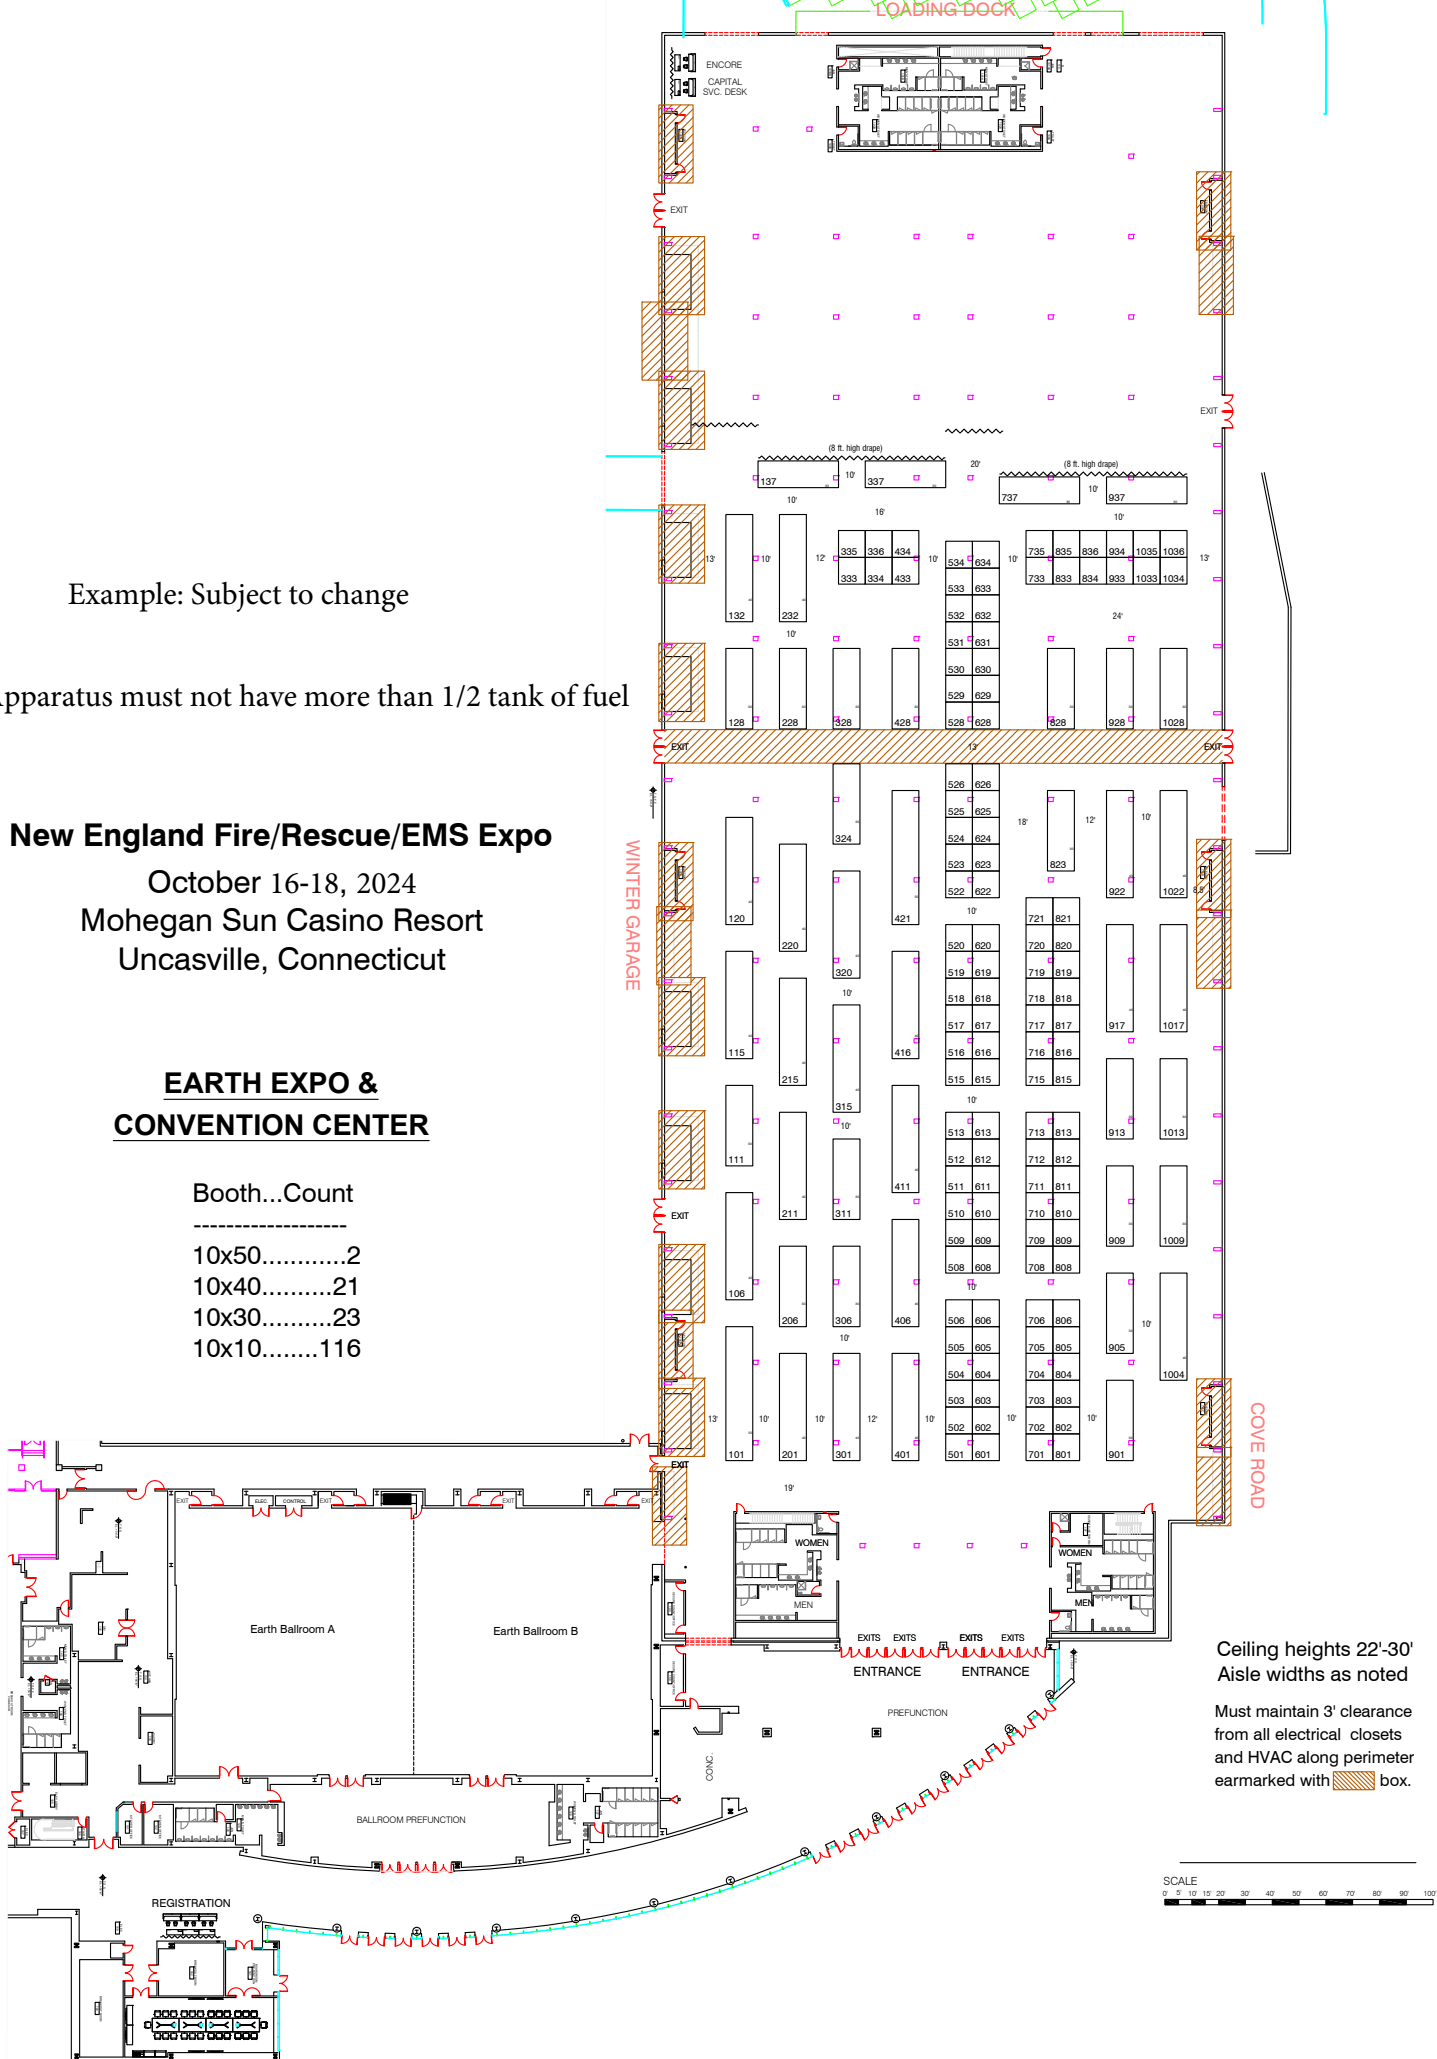

Ceiling heights 22'-30'  
Aisle widths as noted

Must maintain 3' clearance  
from all electrical closets  
and HVAC along perimeter  
earmarked with  box.

